


TRANSITIONAL HOME ENVIRONMENT

LIFESTYLE OPTION CHOICES

NOTE(PER OPTION #6):  
ACCESSIBLE ELECTRICAL RECEPTACLES, SWITCH & CONTROL HEIGHTS.(CBC 1136A-1142A)  
ALL ELECTRICAL BOXES TO BE LOCATED MIN. 15 INCHES(BOTTOM OF THE BOX), ABOVE FINISHED FLOOR & MAX. 48 INCHES(TOP OF THE BOX), ABOVE FINISHED FLOOR.  
SWITCHES & CONTROLS SHALL HAVE A MAX. HEIGHT OF 48 INCHES ABOVE FINISHED FLOOR.

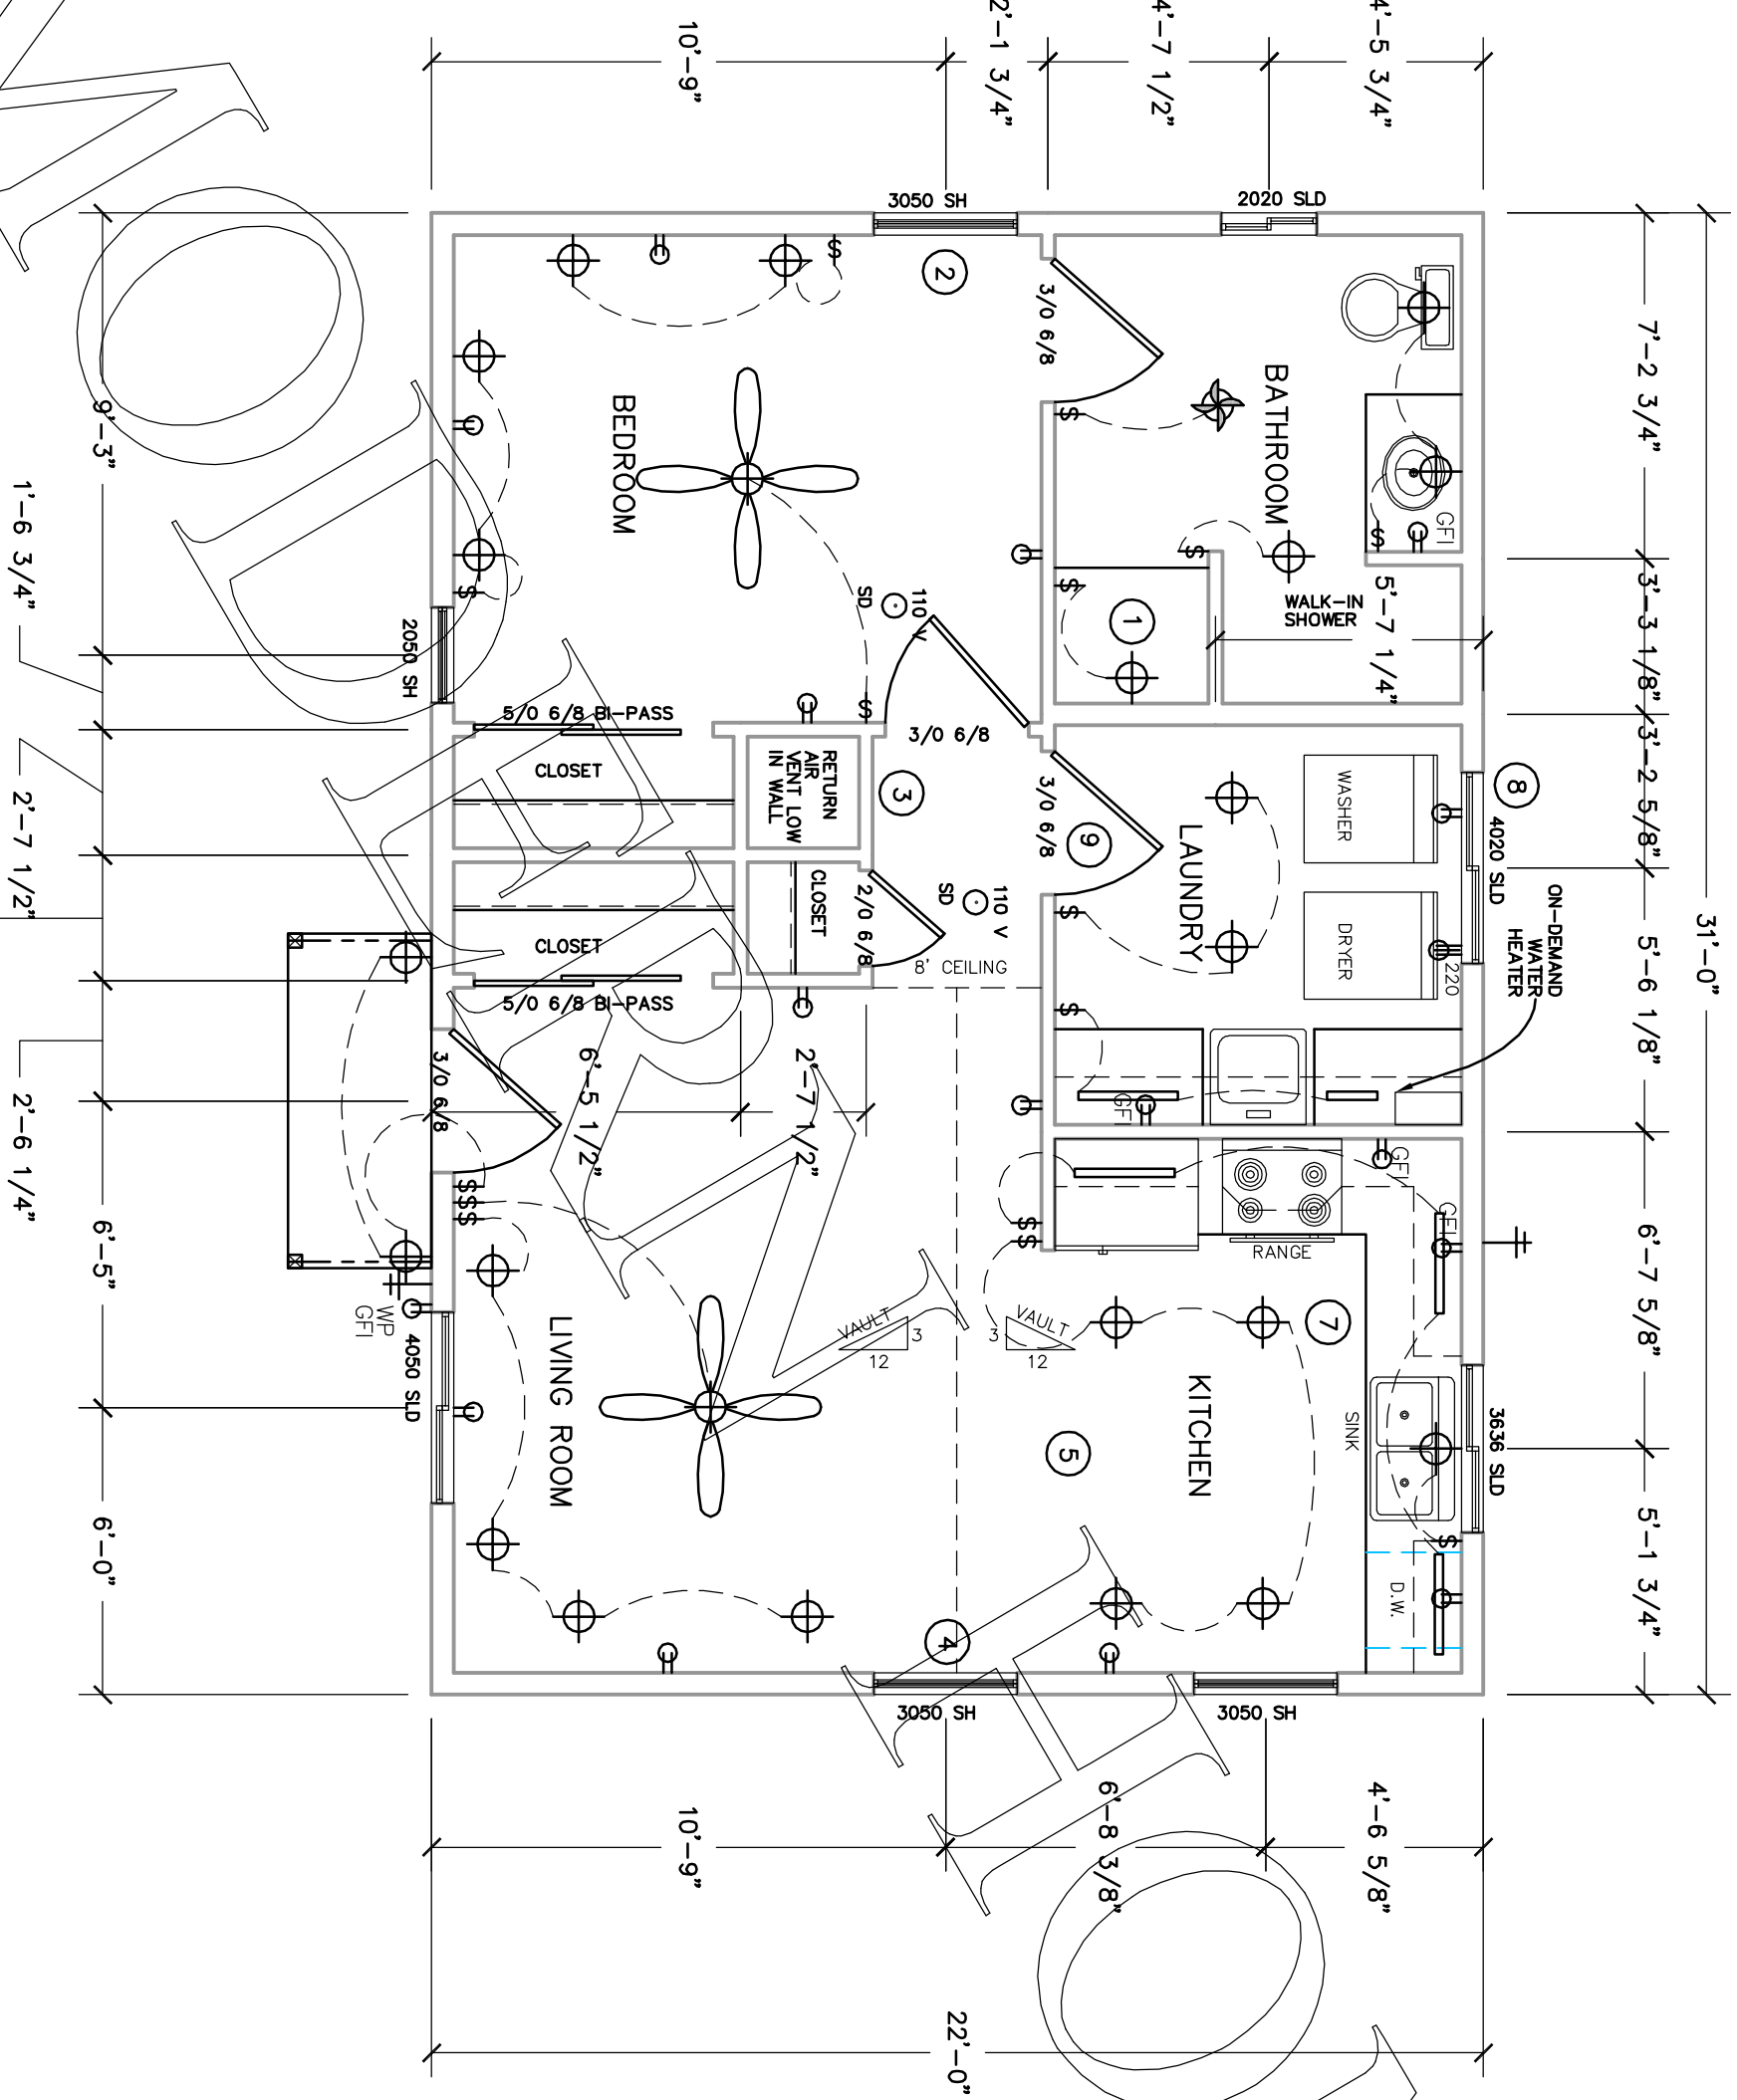

NOTE(PER OPTION #7):  
Kitchens (1133A)  
Removable base cabinets: (1133A.3)  
\* Directly under the kitchen sink counter area in order to provide clearance for wheelchairs.  
\* Use of specialized tools is not permitted.  
\* Finish floor beneath kitchen sink counter area extended to the wall.  
Countertops: (1133A.4)  
\* 30" minimum linear length required for the kitchen sink.  
\* Additional 30" minimum for a work surface.  
\* Sink and work surface may be a single integral unit, 60" minimum long: or  
\* Separate components.  
\* Exception: Two 15" wide breadboards may be provided in lieu of 30" countertop work surface.  
Repositionable countertops: (1133A.4.1)  
\* Provided in a minimum of 5 % of the covered multifamily dwelling units.  
\* Kitchen sinks and work surface spaces designed to enable repositioning to 28" height.  
\* Base cabinets directly under kitchen sinks and work surfaces shall be removable.  
\* Sides of adjacent cabinets and the back wall, which may become exposed to moisture or food when a countertop is lowered, constructed of durable, nonabsorbent materials.  
\* Finished flooring extended to the wall beneath the sink and work surface.  
Exceptions:  
\* Stone, cultured stone and tiled countertops may be used without meeting the requirements.  
\* Two 15" wide breadboards may be provided in lieu of 30" work surface.  
Lower shelving: (1133A.5)  
\* Lower shelving and/or drawer space shall be provided at a height 48" maximum above the floor.  
Kitchen sink faucet controls: (1133A.6)  
\* Operable with one hand, with no tight grasping, pinching or twisting of the wrist.  
\* Controls activated with force not greater than 5 pounds.  
\* Acceptable designs: lever-operated, push-type and electronically controlled mechanisms.  
\* Self-closing valves are allowed if the faucet remains open for at least 10 seconds.

OPTIONS:

- ☐ 1. STORAGE IN PLACE OF SINK.
- ☐ 2. EASY OPEN CASEMENT WINDOW.
- ☐ 3. FURNACE FILTER LOW IN WALL.
- ☐ 4. ALTERNATE ENTRY/EASY OPEN CASEMENT WINDOW.
- ☐ 5. ALTERNATE LIGHTING PLAN, ENHANCED LIGHTING DESIGN.
- ☐ 6. ACCESSIBLE ELECTRICAL.
- ☐ 7. ACCESSIBLE KITCHEN CABINETS, COUNTERS, & FAUCETS.
- ☐ 8. WINDOW CHANGE FOR FRONT LOAD LAUNDRY.
- ☐ 9. DOOR MOVES TO ACCOMMODATE ACCESSIBLE FRONT LOAD LAUNDRY DESIGN.

LEGEND

- SWITCH
- RECEPTACLE
- LIGHT
- FAN LIGHT
- SMOKE DETECTOR
- HOSE BIB